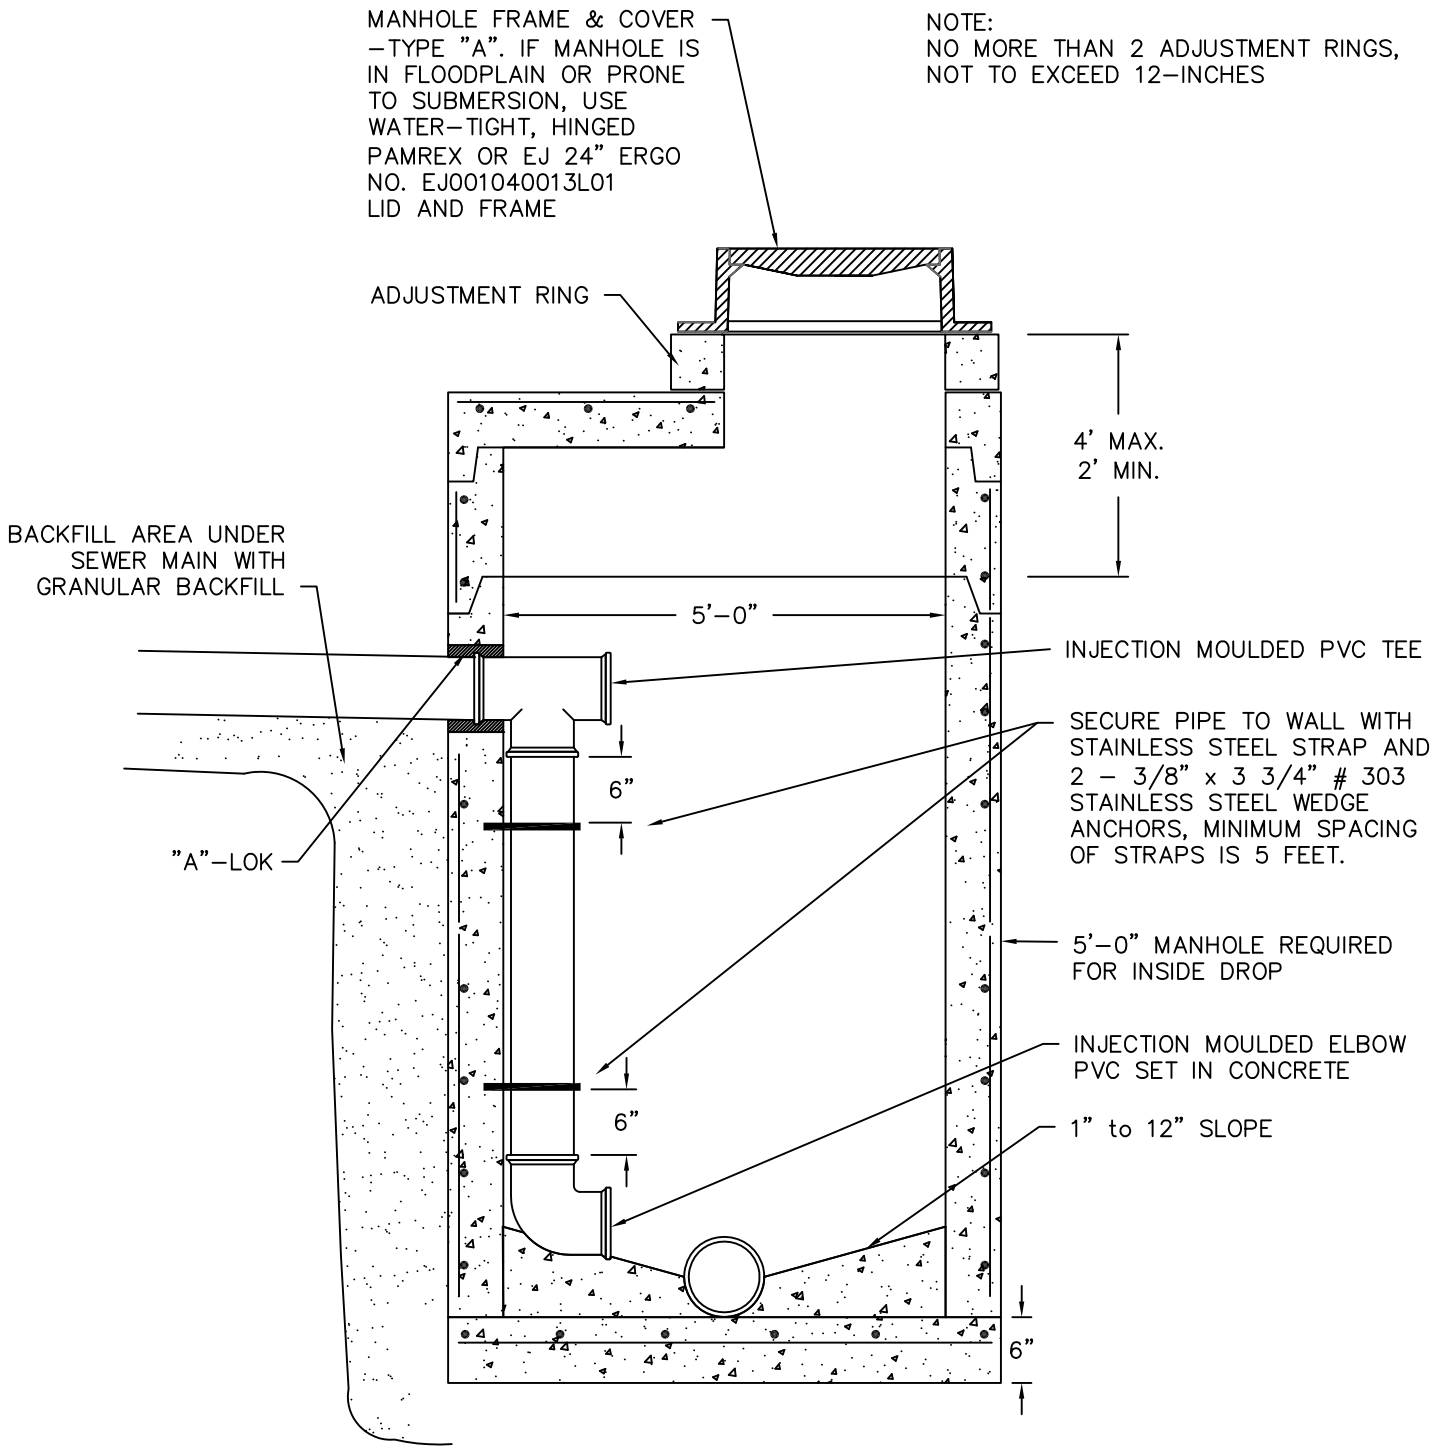

DISTANCE FROM PIPE INLET TO MANHOLE FLOWLINE FOR 8" PIPE.
0'–2' BUILD INSIDE FLUME
2'–3' SPECIAL DESIGN REQUIRED
3'– BUILD DROP MANHOLE

CONSTRUCTION METHODS FOR DROP MANHOLE TO BE SAME AS MANHOLE SAN–3

INSIDE DROP MANHOLE
8" TO 24" PIPE

DEPARTMENT OF PUBLIC WORKS SPRINGFIELD, MO.	INSIDE DROP MANHOLE	ADOPTED: 7–1–2015 SAN–6