


TYPE III POWER SUPPLY

TS-9A


ADOPTED:

Cabinet Requirements:
120/240 VAC, 1-Phase, 3-wire, 100 AMPS
Maximum; Rainproof -Type 3R, Aluminum
Enclosure, unpainted bare

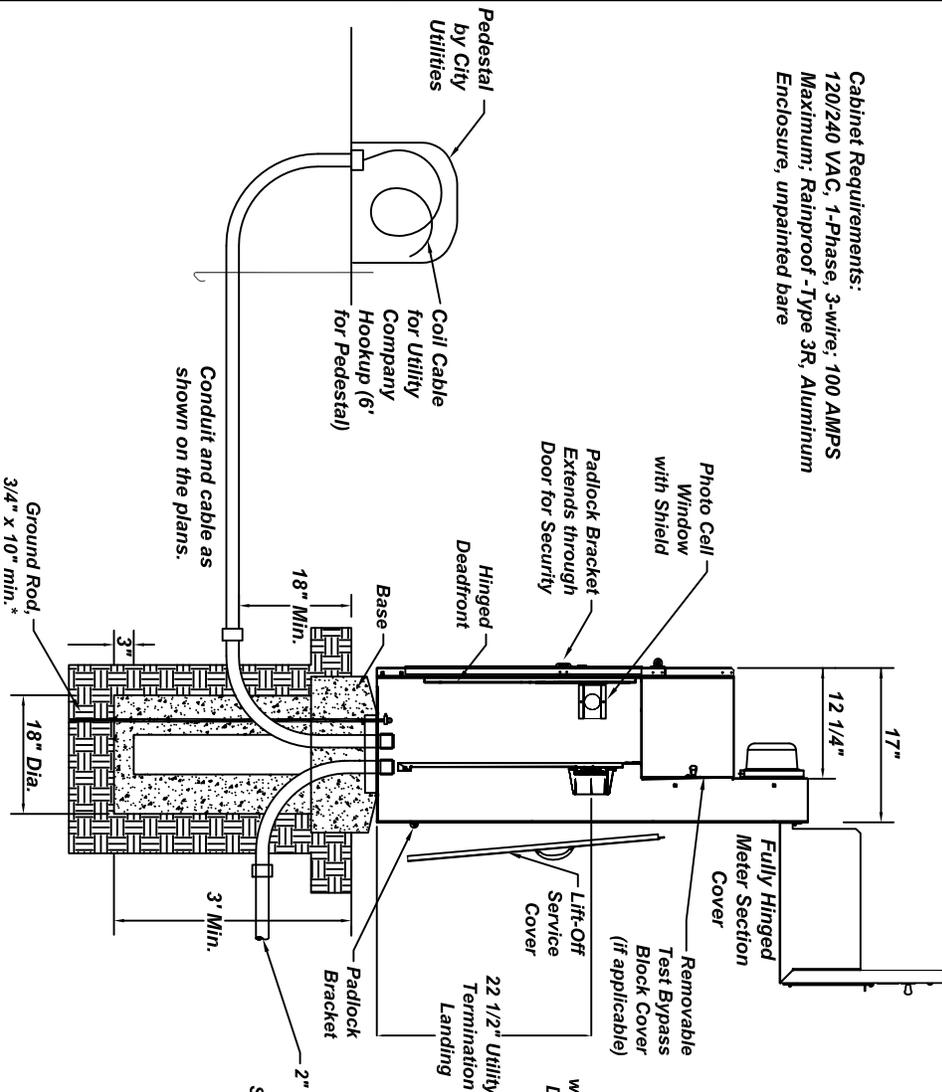


SIDE ELEVATION

*Drive two ground rods six feet apart.

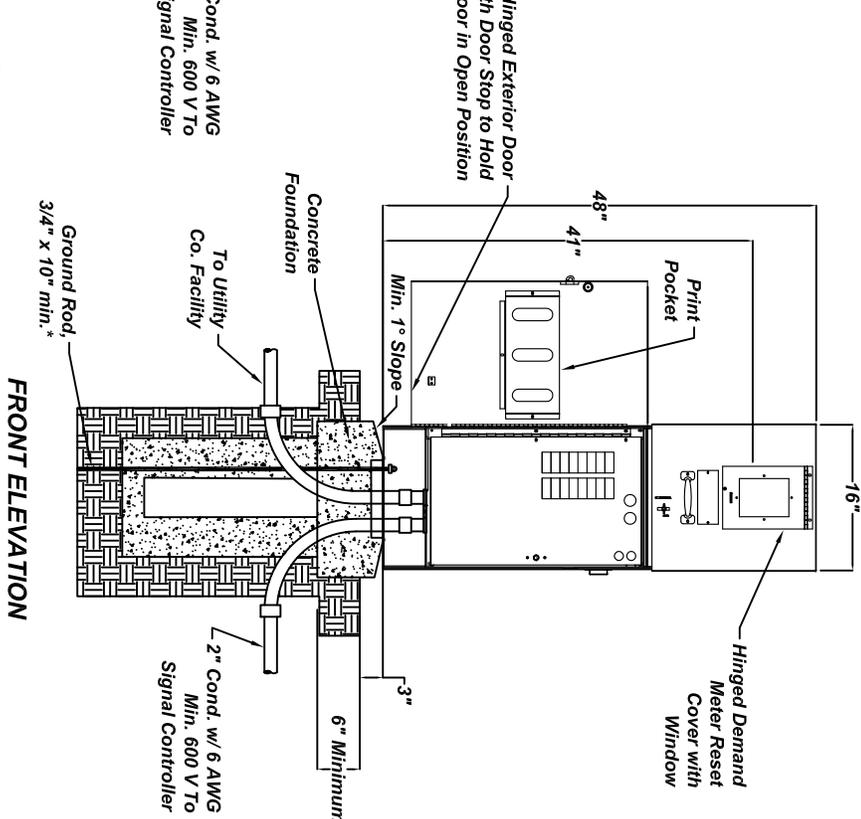

FRONT ELEVATION

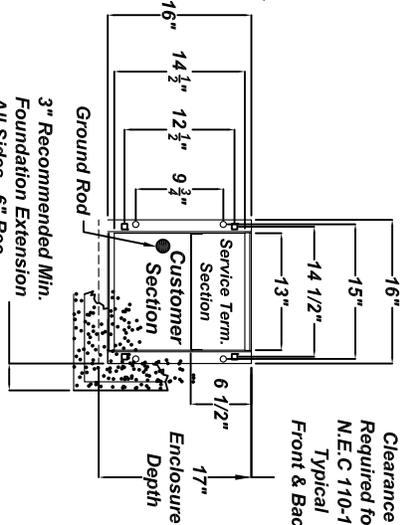

MOUNTING BASE DETAIL

NOT TO SCALE

The Contractor is required to obtain an Electrical permit from Building Development Services for new or relocated power supplies. The permit fee is the responsibility of the Contractor.