


NOTES:

- 1) MINIMUM 1% DESIGN SLOPE ON CASING AND CARRIER PIPES
- 2) IF PVC IS NOT TO BE USED AS CARRIER PIPE, CONTRACTOR SHALL SUBMIT A DESIGN FOR APPROVAL PRIOR TO CONSTRUCTION
- 3) RUBBER END SEAL, WITH STAINLESS STEEL BANDS, TO BE INSTALLED AT BOTH ENDS OF CASING PIPE
- 4) END ELEVATIONS AND SLOPE OF CASING PIPE TO BE FIELD VERIFIED PRIOR TO ACCEPTANCE
- 5) MIN. WALL THICKNESS 0.25"

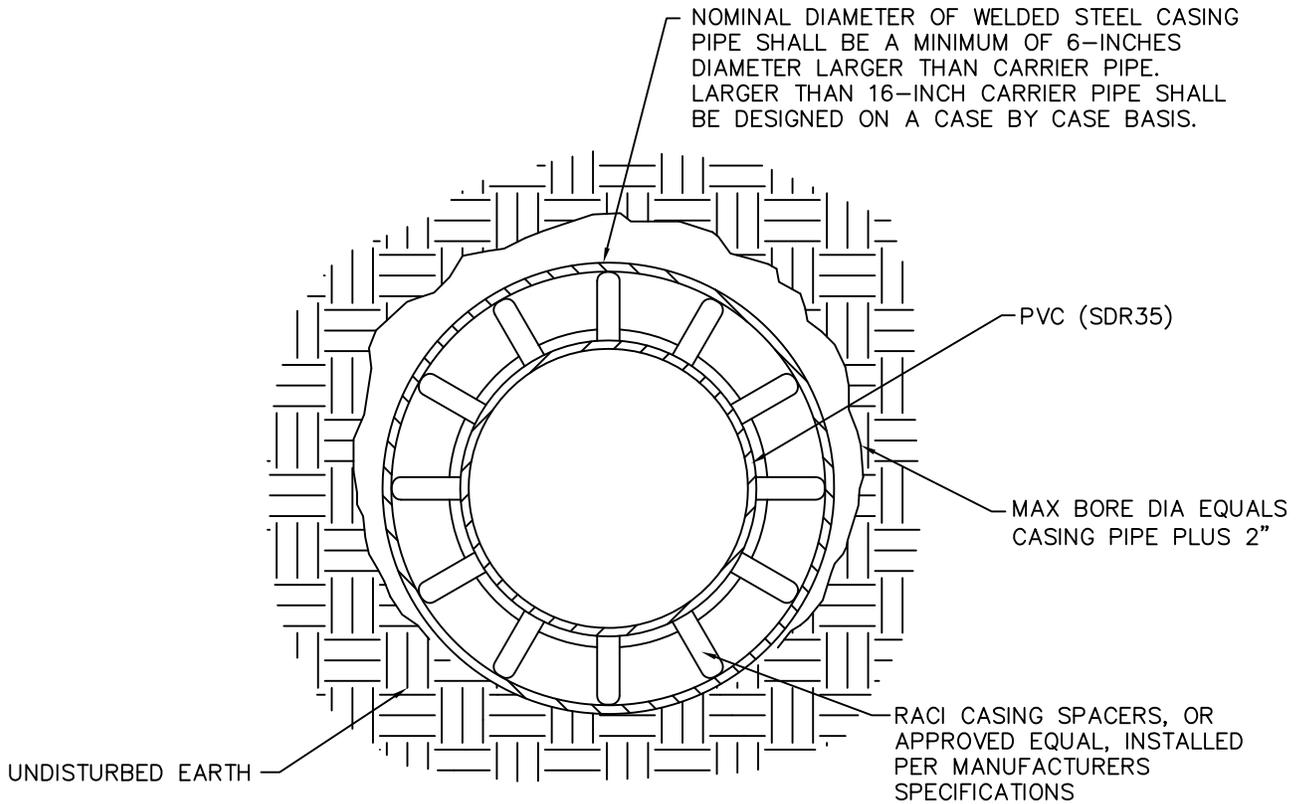

BORING CASING

TREATMENT FOR 8" SEWER, OTHER SIZES TO BE SIMILAR, APPROVAL WILL BE REQUIRED.