
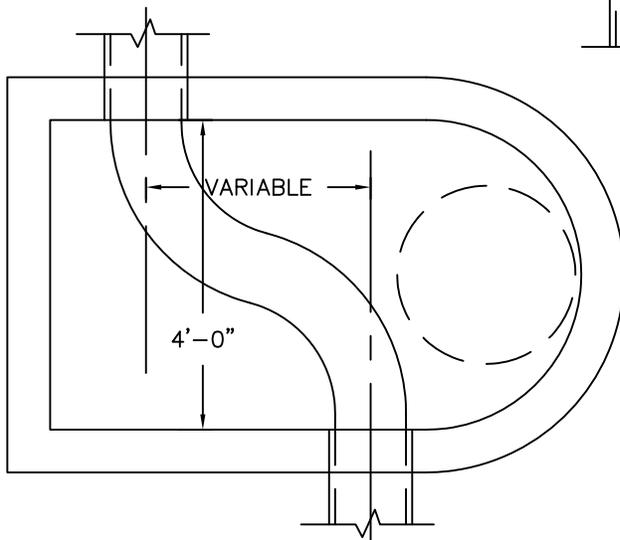


NOTES:

1. WALLS SHALL BE POURED CONCRETE OR PRECAST.
2. THICKNESS OF WALLS TO BE INCREASED TO 12" AT 12' BELOW UNDERSIDE OF FRAME.
3. CONSTRUCTION METHODS TO BE SAME AS STANDARD MANHOLES.

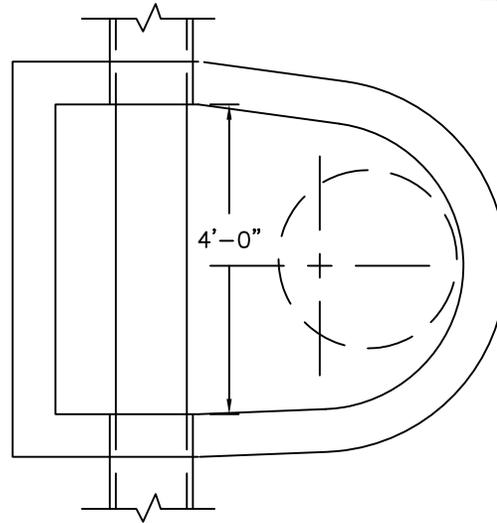

NOTE:  
NO MORE THAN 2 ADJUSTMENT RINGS,  
NOT TO EXCEED 18-INCHES